
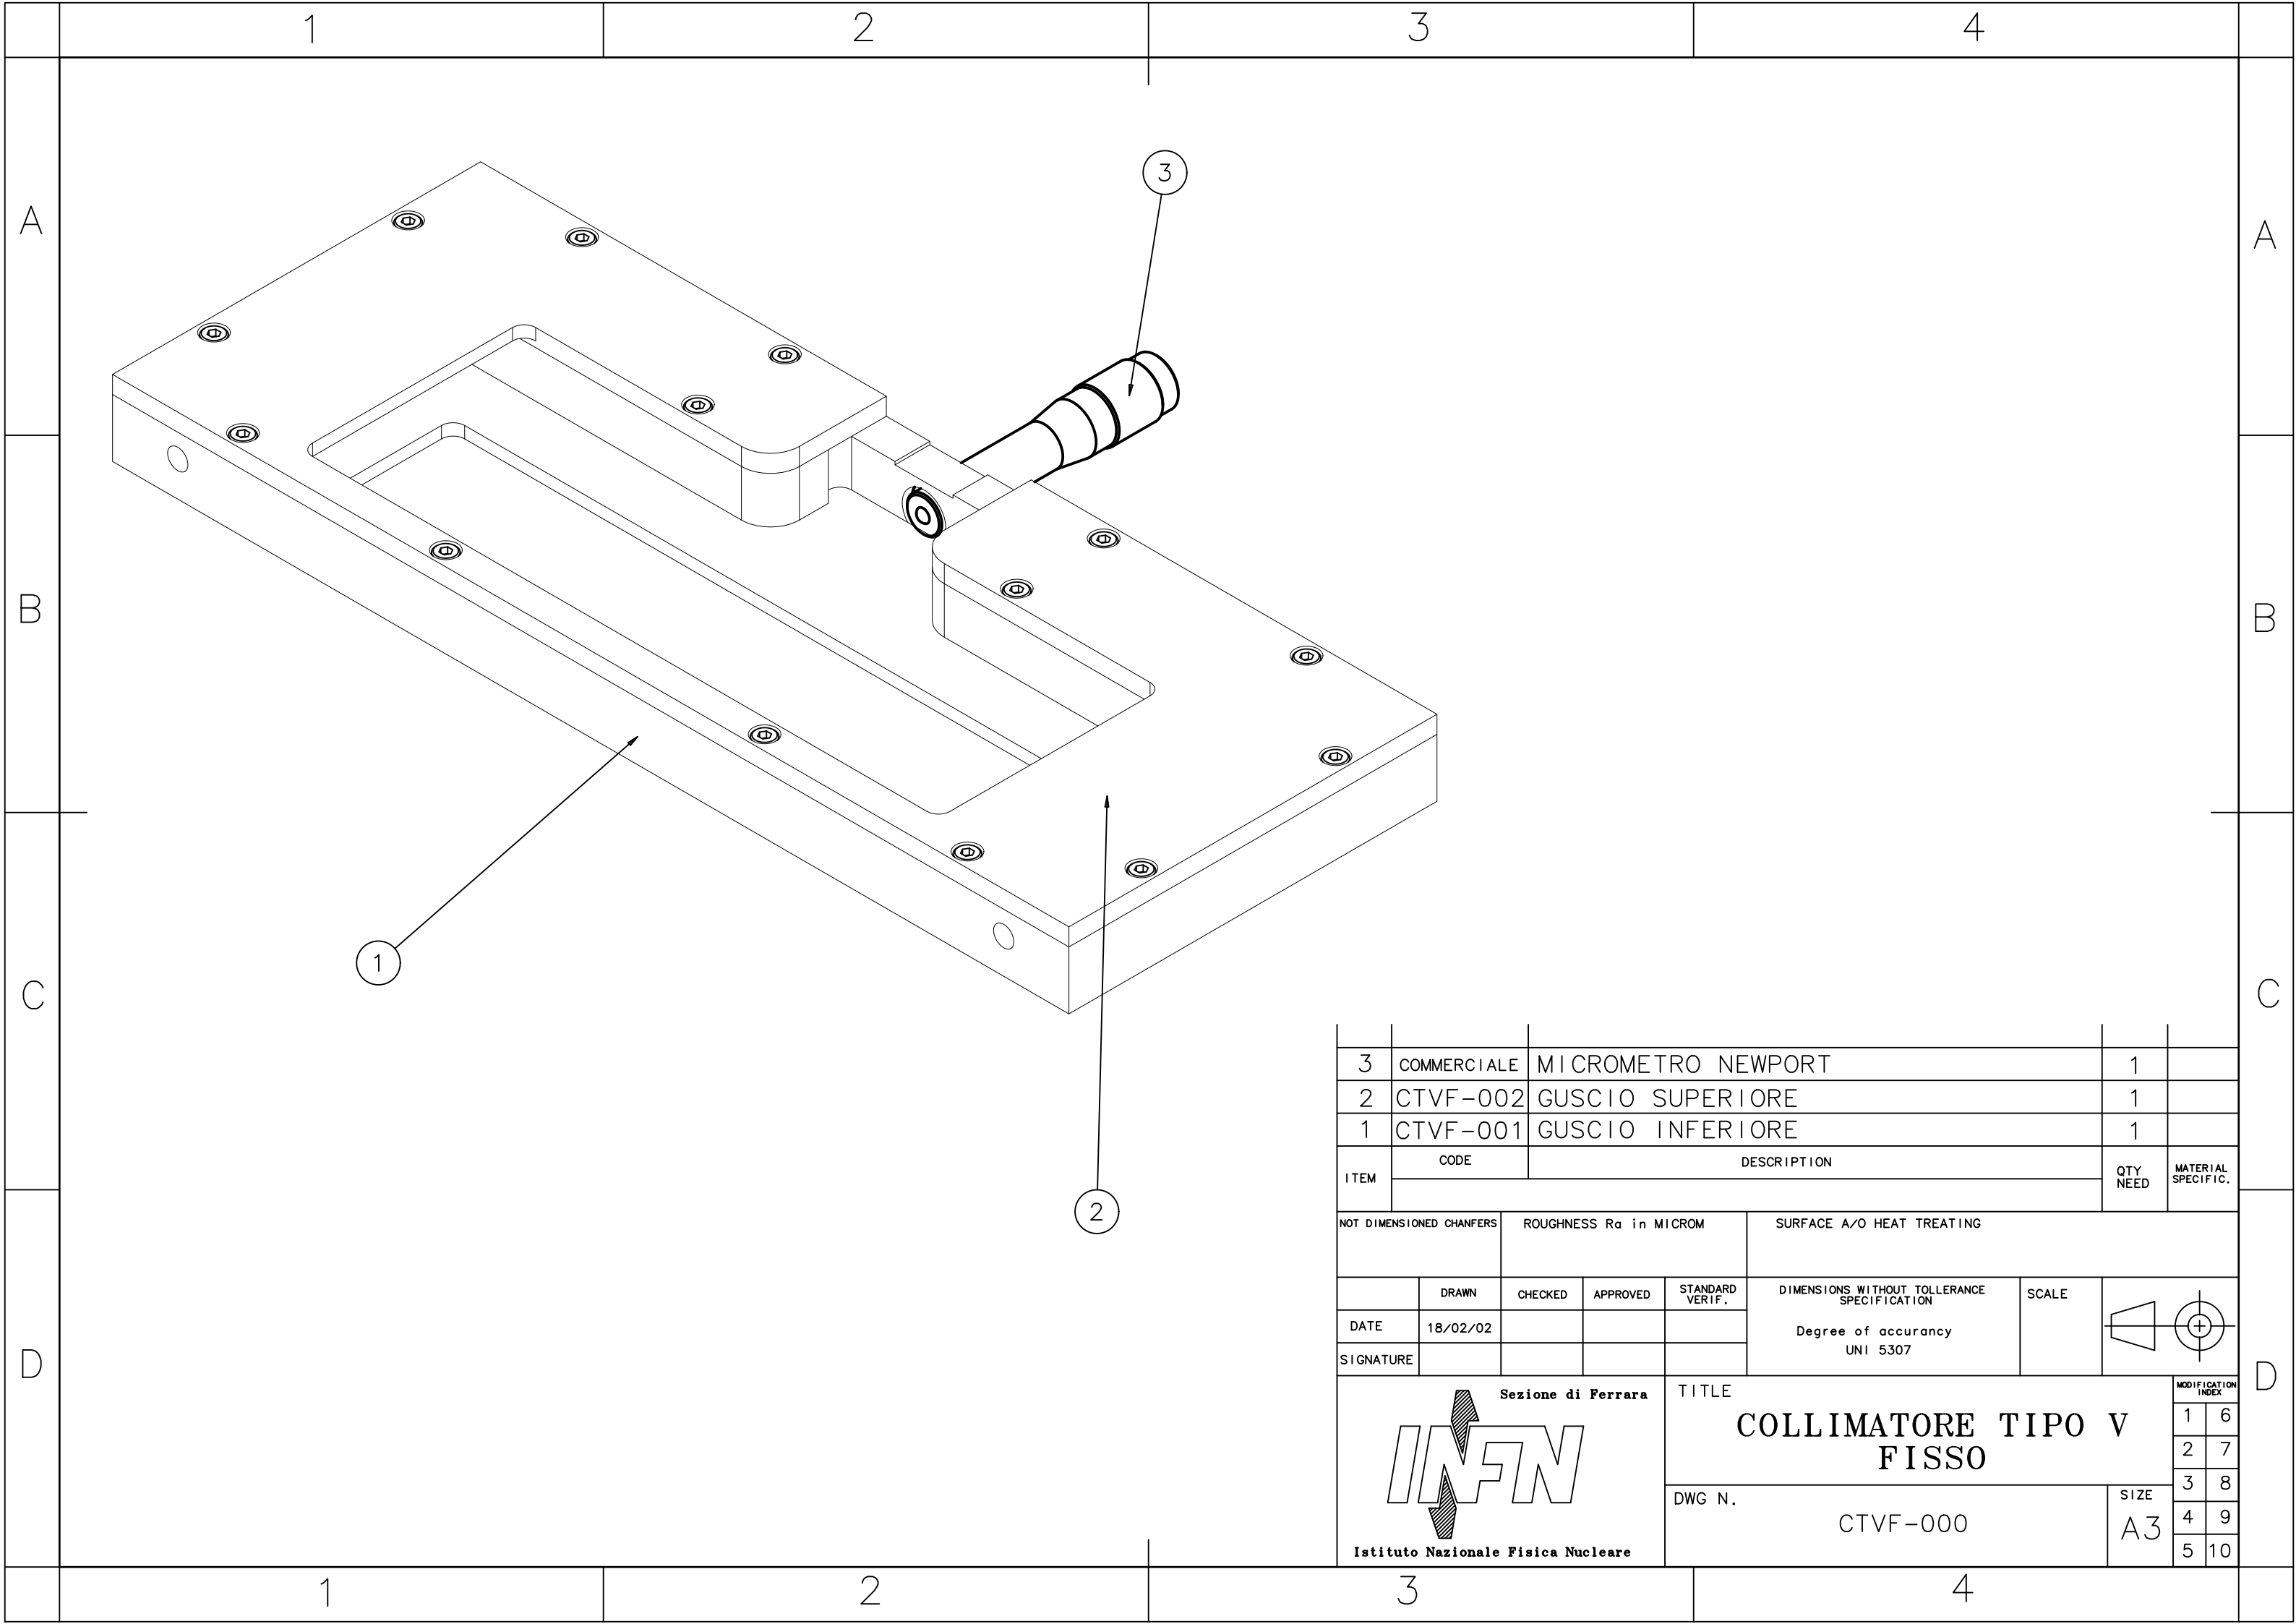




3	COMMERCIALE	MICROMETRO NEWPORT			1													
2	CTVF-002	GUSCIO SUPERIORE			1													
1	CTVF-001	GUSCIO INFERIORE			1													
ITEM	CODE	DESCRIPTION			QTY NEED	MATERIAL SPECIFIC.												
NOT DIMENSIONED CHANFERS		ROUGHNESS Ra in MICROM		SURFACE A/O HEAT TREATING														
	DRAWN	CHECKED	APPROVED	STANDARD VERIF.	DIMENSIONS WITHOUT TOLLERENCE SPECIFICATION Degree of accuracy UNI 5307	SCALE 												
DATE	18/02/02																	
SIGNATURE																		
 Sezione di Ferrara Istituto Nazionale Fisica Nucleare				TITLE		<table><tr><td colspan="2">MODIFICATION INDEX</td></tr><tr><td>1</td><td>6</td></tr><tr><td>2</td><td>7</td></tr><tr><td>3</td><td>8</td></tr><tr><td>4</td><td>9</td></tr><tr><td>5</td><td>10</td></tr></table>	MODIFICATION INDEX		1	6	2	7	3	8	4	9	5	10
				MODIFICATION INDEX														
				1	6													
				2	7													
				3	8													
4	9																	
5	10																	
COLLIMATORE TIPO V FISSO																		
DWG N.		SIZE																
CTVF-000		A3																